
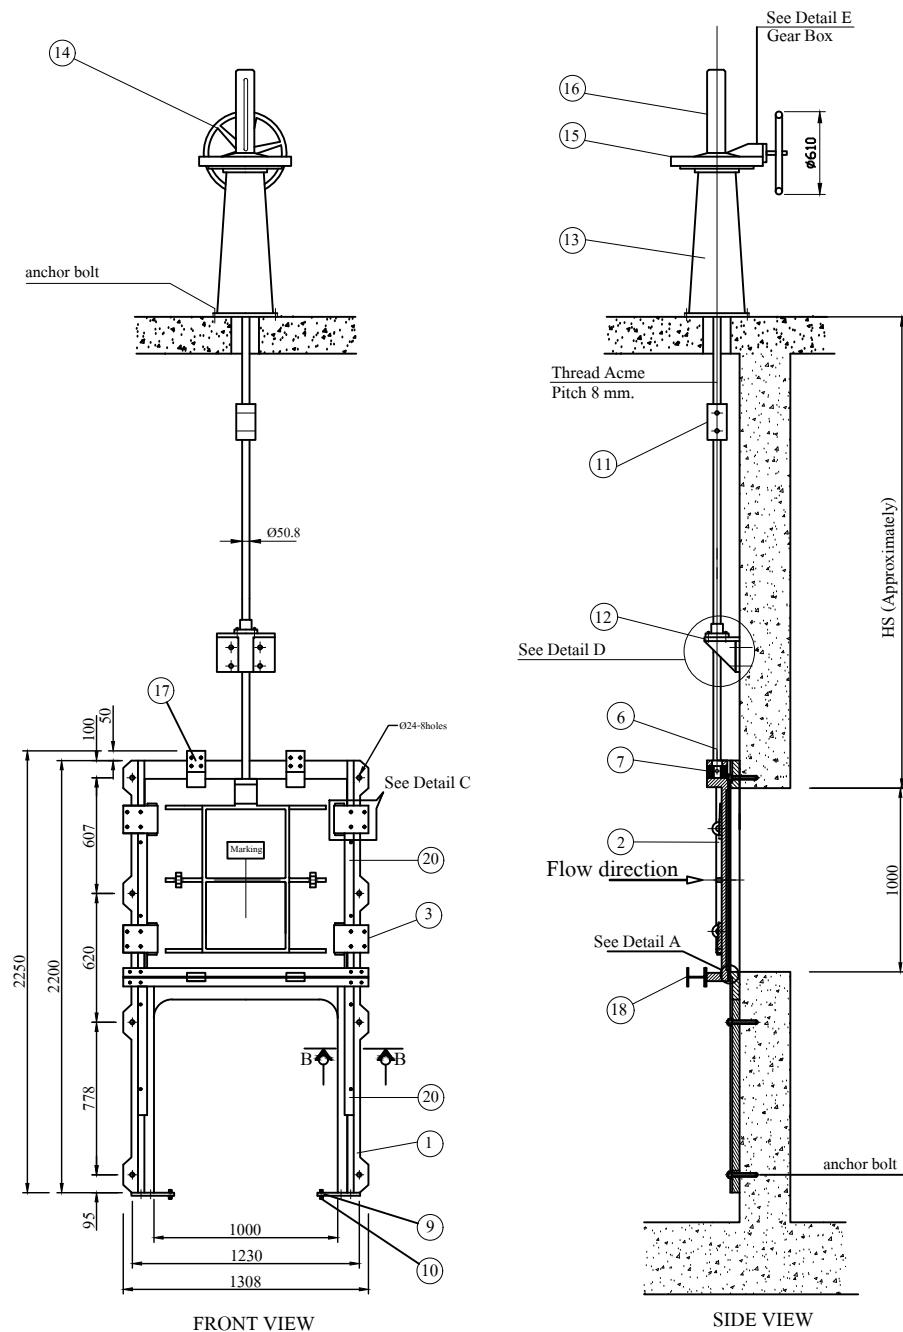
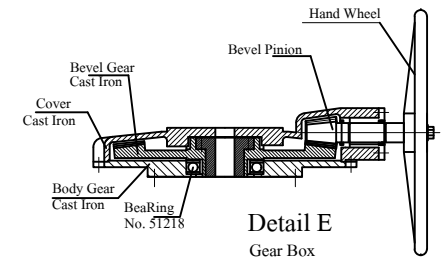
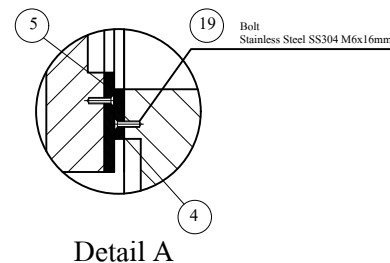



Marking


CPE
 SIZE.1000 x 1000
 DATE...../...../.....
 LOT..... No.



Remark

Coating : All surface shall be coated with Coal ter Epoxy
 (black colour) dry film thickness shall not be less than 200
 microns

20	Side Bar	4	Cast Iron	ASTM A126Class B
19	Bolts	1set	Stainless Steel	ASTM A276Type304
18	Pivot (4"x 4" L1344 mm.)	1	Steel	A36
17	Top Wedge	2	Cast Iron	ASTM A126Class B
16	Protection tube	1	Carbon Steel	ASTM A36
15	Gear box	1 set	"CPE" Ratio = 6:1	
14	Hand wheel	1	Cast Iron	ASTM A126 Class B
13	Floor stand	1		
12	Stem guide	1	Stainless Steel	ASTM A276Type304
11	Stem coupling	1		
10	Bolts For Stopper	1set	Cast Iron	ASTM A126
9	Stopper	2	Bronze	B 62
8	Stem guide bushings	1	Stainless Steel	ASTM A276Type304
7	Thrust nut	1	Bronze	B 62
6	Stem	1		
5	Disc seat	1	Cast Iron	ASTM A126 Class B
4	Body seat	1		
3	Side Wedge	4	Cast Iron	ASTM A126 Class B
2	Disc	1		
1	Frame	1		
NO.	DESCRIPTIONS	Q'TY	MATERIALS	STANDARDS



TITLE : Assembly Weir Gate Size 1000x1000 mm.

DATE : 28-03-17	PROJECT NAME :
DRAWN BY : Boonsaluk	GENERAL
DESIGNED BY : Boonsaluk	SCALE : Not to Scale
CHECKED BY :	REVISIONS :
APPROVED BY :	DWG. NO : WG-1-20